


ELEVATION

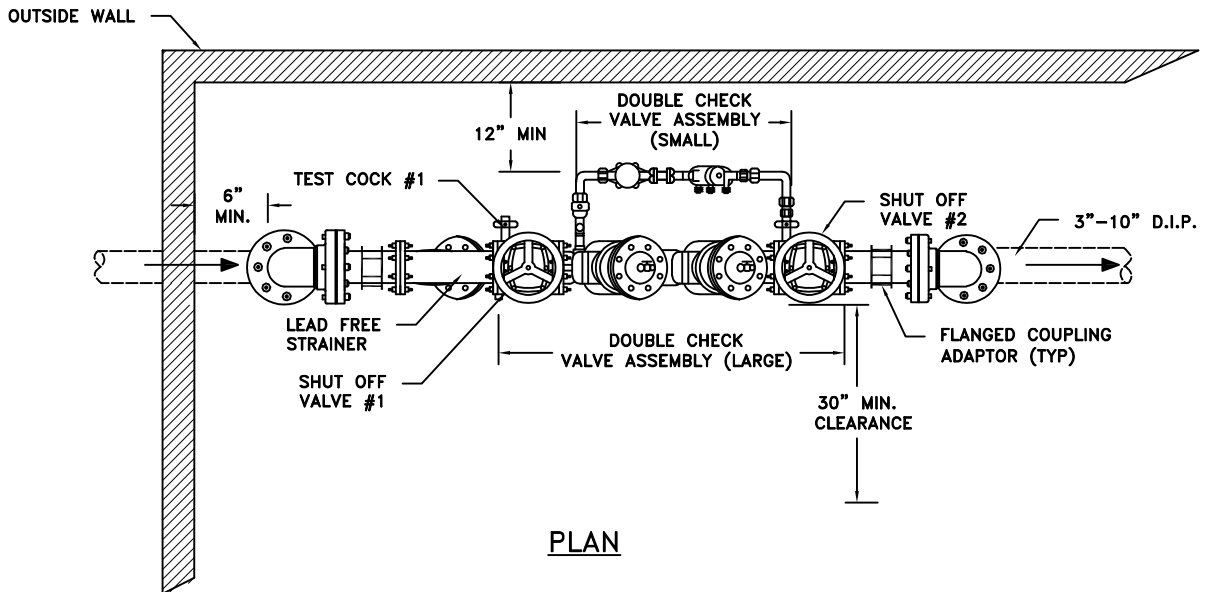

PLAN

>2" DOUBLE CHECK VALVE BACKFLOW PREVENTER-INTERIOR

NOTES:

1. BFD ASSEMBLY SHALL NOT BE SUBJECT TO FLOODING.
2. ALL PIPE 3" - 10" SHALL BE D.I.P. FROM THE TAP AT THE MAIN TO 5' PAST SHUT OFF VALVE #2.
3. RESTRAINED JOINTS SHALL BE WITH MEGA LUG RESTRAINTS OR APPROVED EQUAL.
4. PROVIDE LEAD FREE STRAINER WHEN DIRECTED BY AW PROJECT MANAGER.
5. BFD ASSEMBLY SHALL BE READILY ACCESSIBLE PER THE UFC.

REVISIONS
01/16 - MSG EDITS
12/22 - MSG EDITS

AMERICAN WATER STANDARD
CIVIL
BACKFLOW PREVENTER-INTERIOR
>2" DOUBLE CHECK VALVE

AMERICAN WATER MILITARY SERVICES GROUP
CAMDEN, NJ 08102

AMERICAN WATER M.S.G.
1 WATER STREET
CAMDEN, NJ 08102



DRAWN BY JRQ
PROJECT ENG'R PDK
APPROVED

DATE 12-06-11
PROJECT IP

USE DIMENSIONS ONLY
SCALE N.T.S.

USE APPROVED DRAWINGS ONLY
FOR CONSTRUCTION PURPOSES

MSG-W-20

FINAL

MSG-W-20