


ELEVATION

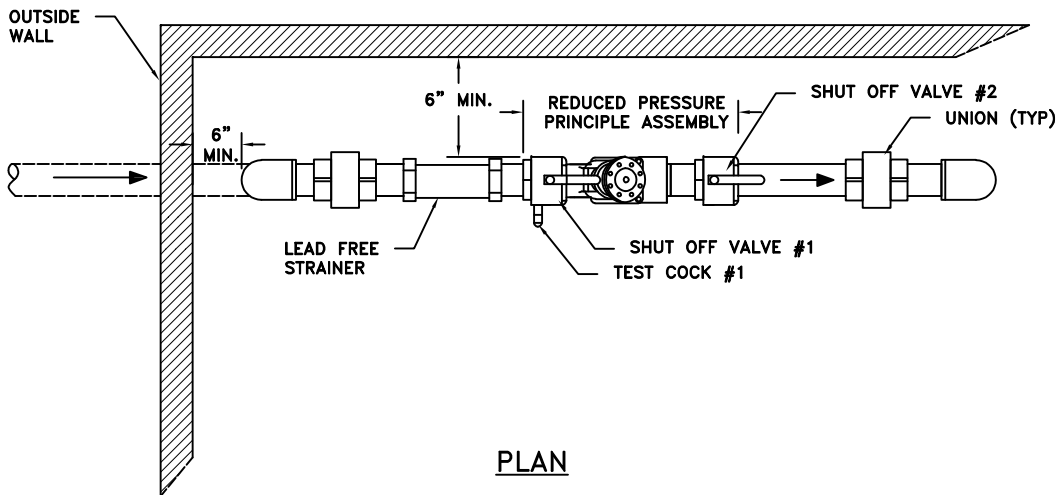

PLAN

3/4" - 2" REDUCED PRESSURE PRINCIPLE ASSEMBLY BACKFLOW PREVENTER-INTERIOR

NOTES:

1. TEST COCK #1 SHALL BE UPSTREAM OF SHUT OFF VALVE #1 AND IS PART OF THE APPROVED ASSEMBLY. ALL TEST COCKS MUST BE ON THE OUTSIDE OR TOP. ASSEMBLIES SHALL BE INSTALLED UPRIGHT AND IN THE HORIZONTAL POSITION.
2. PROVIDE STRAINER WHEN DIRECTED BY AW PROJECT MANAGER.
3. BFD ASSEMBLY SHALL NOT BE SUBJECT TO FLOODING.

REVISIONS
12/13 - MSG EDITS
01/16 - MSG EDITS
12/22 - MSG EDITS

AMERICAN WATER STANDARD
CIVIL
3/4"-2" BACKFLOW PREVENTER-INTERIOR
REDUCED PRESSURE PRINCIPLE ASSEMBLY

AMERICAN WATER MILITARY SERVICES GROUP
CAMDEN, NJ 08102

AMERICAN WATER M.S.G.
1 WATER STREET
CAMDEN, NJ 08102



DRAWN BY JRQ
PROJECT ENG'R PDK
APPROVED

DATE 12-06-11
PROJECT IP

USE DIMENSIONS ONLY
SCALE N.T.S.

USE APPROVED DRAWINGS ONLY
FOR CONSTRUCTION PURPOSES

MSG-W-23

FINAL

MSG-W-23